
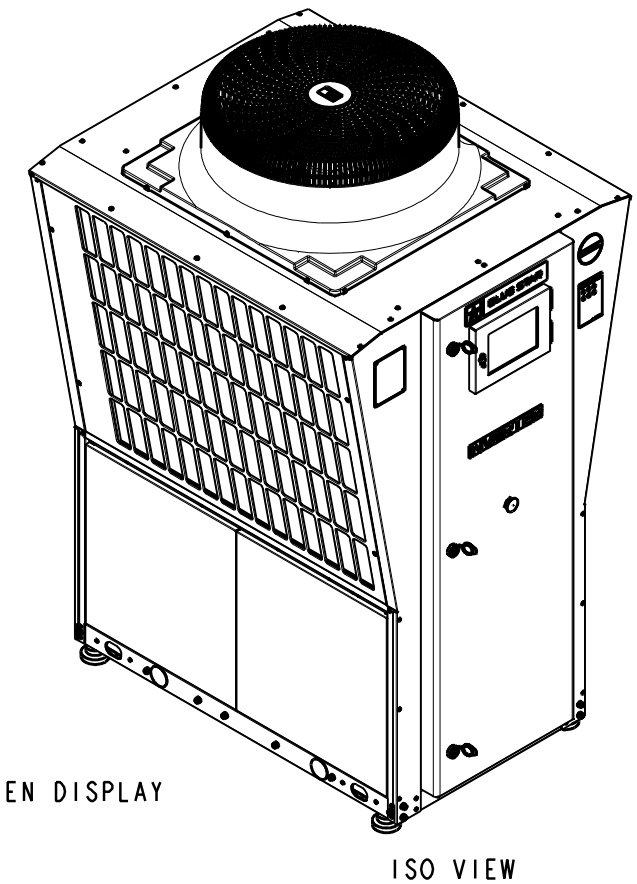
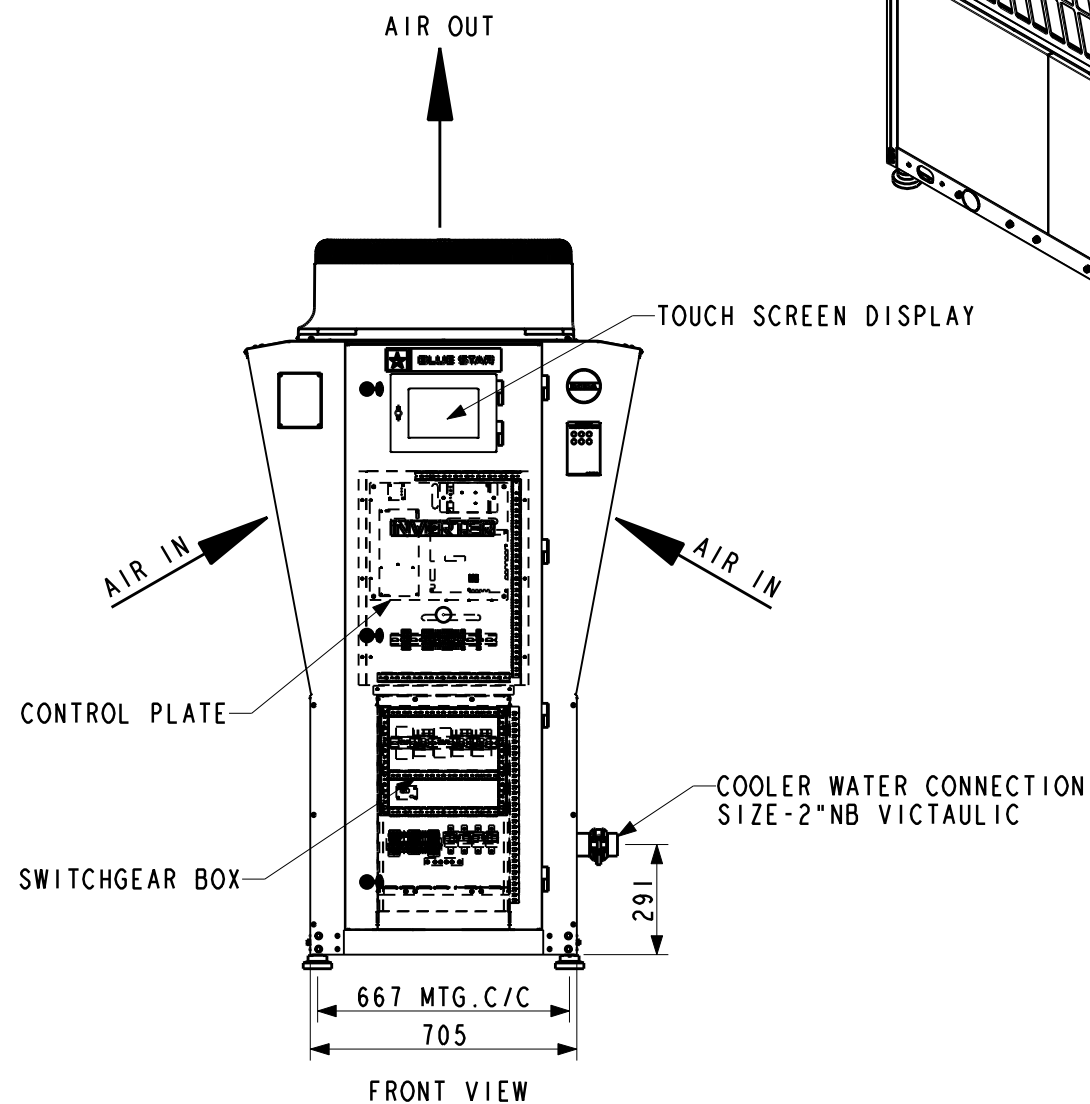
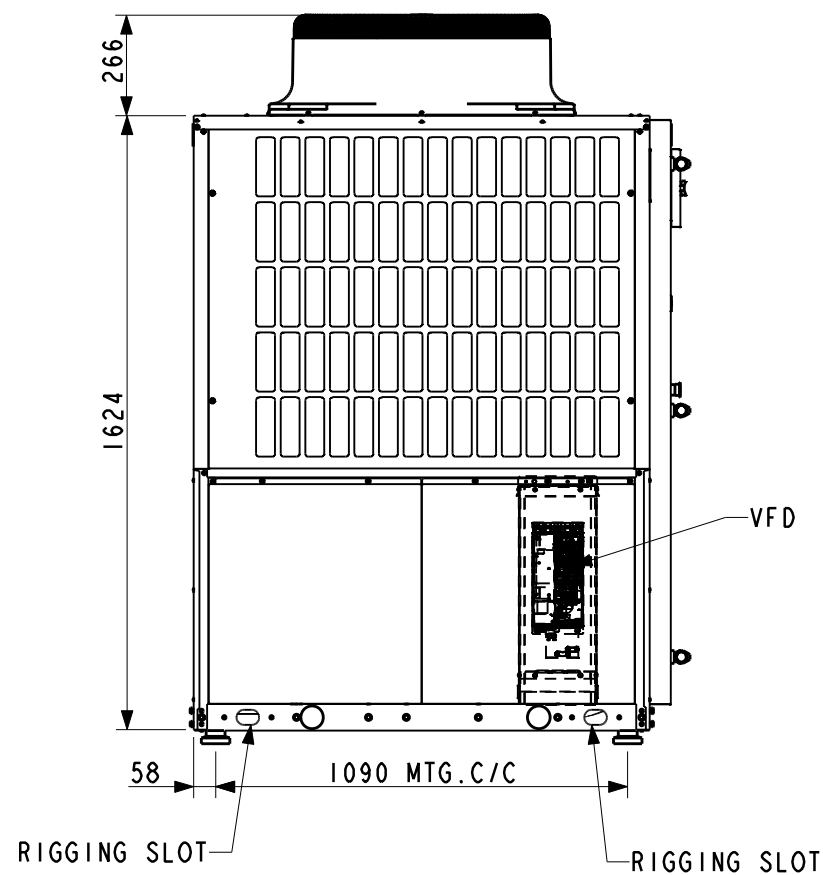


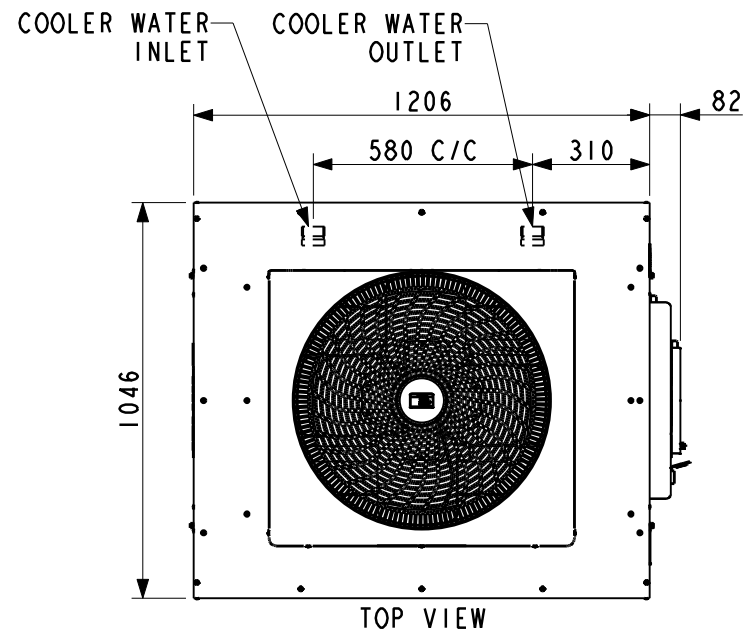

RECOMMENDED CLEARANCES TO PREVENT CONDENSOR AIR RECIRCULATION AND FAULTY OPERATION OF UNIT ARE AS FOLLOWS:

DISTANCE BETWEEN ADJACENT UNITS 12'-0"
NO MORE THAN ONE WALL CAN BE HIGHER THAN TOP OF THE UNIT
UNIT REFR CONNECTION : SWEAT BRAZED TYPE

- 1) SIDE TO WALL 3'-0"
- 2) REAR TO WALL 3'-0"
- 3) TOP 50'-0"
- 4) CONTROL END TO WALL 5'-0"

						SCALE -NTS		CAD ESTIMATED WEIGHT (KG)		-							
								BLUE STAR		GA LAYOUT XAC2VS-012MR3							
								DATE		NAME		DRAWING No. SHT 1 OF 1 REV					
						DRN		Dec-11-18		RM							
						CHD		Dec-11-18		SSG		GA-XAC2VS-012MR3		A			
REV		DATE		ENGINEERING CHANGE		C.N.No.		DRN		CHD						APPD	

ALL DIMENSIONS IN MM UNLESS OTHERWISE SPECIFIED | SYMBOLS: ● SAFETY ● MAJOR ○ MINOR △ REVISION ○ CRITICAL | THIS DOCUMENT IS THE PROPERTY OF BLUE STAR LTD. AND MUST NOT BE USED WITHOUT PRIOR CONSENT | FORMAT NO:BSA3-17B