


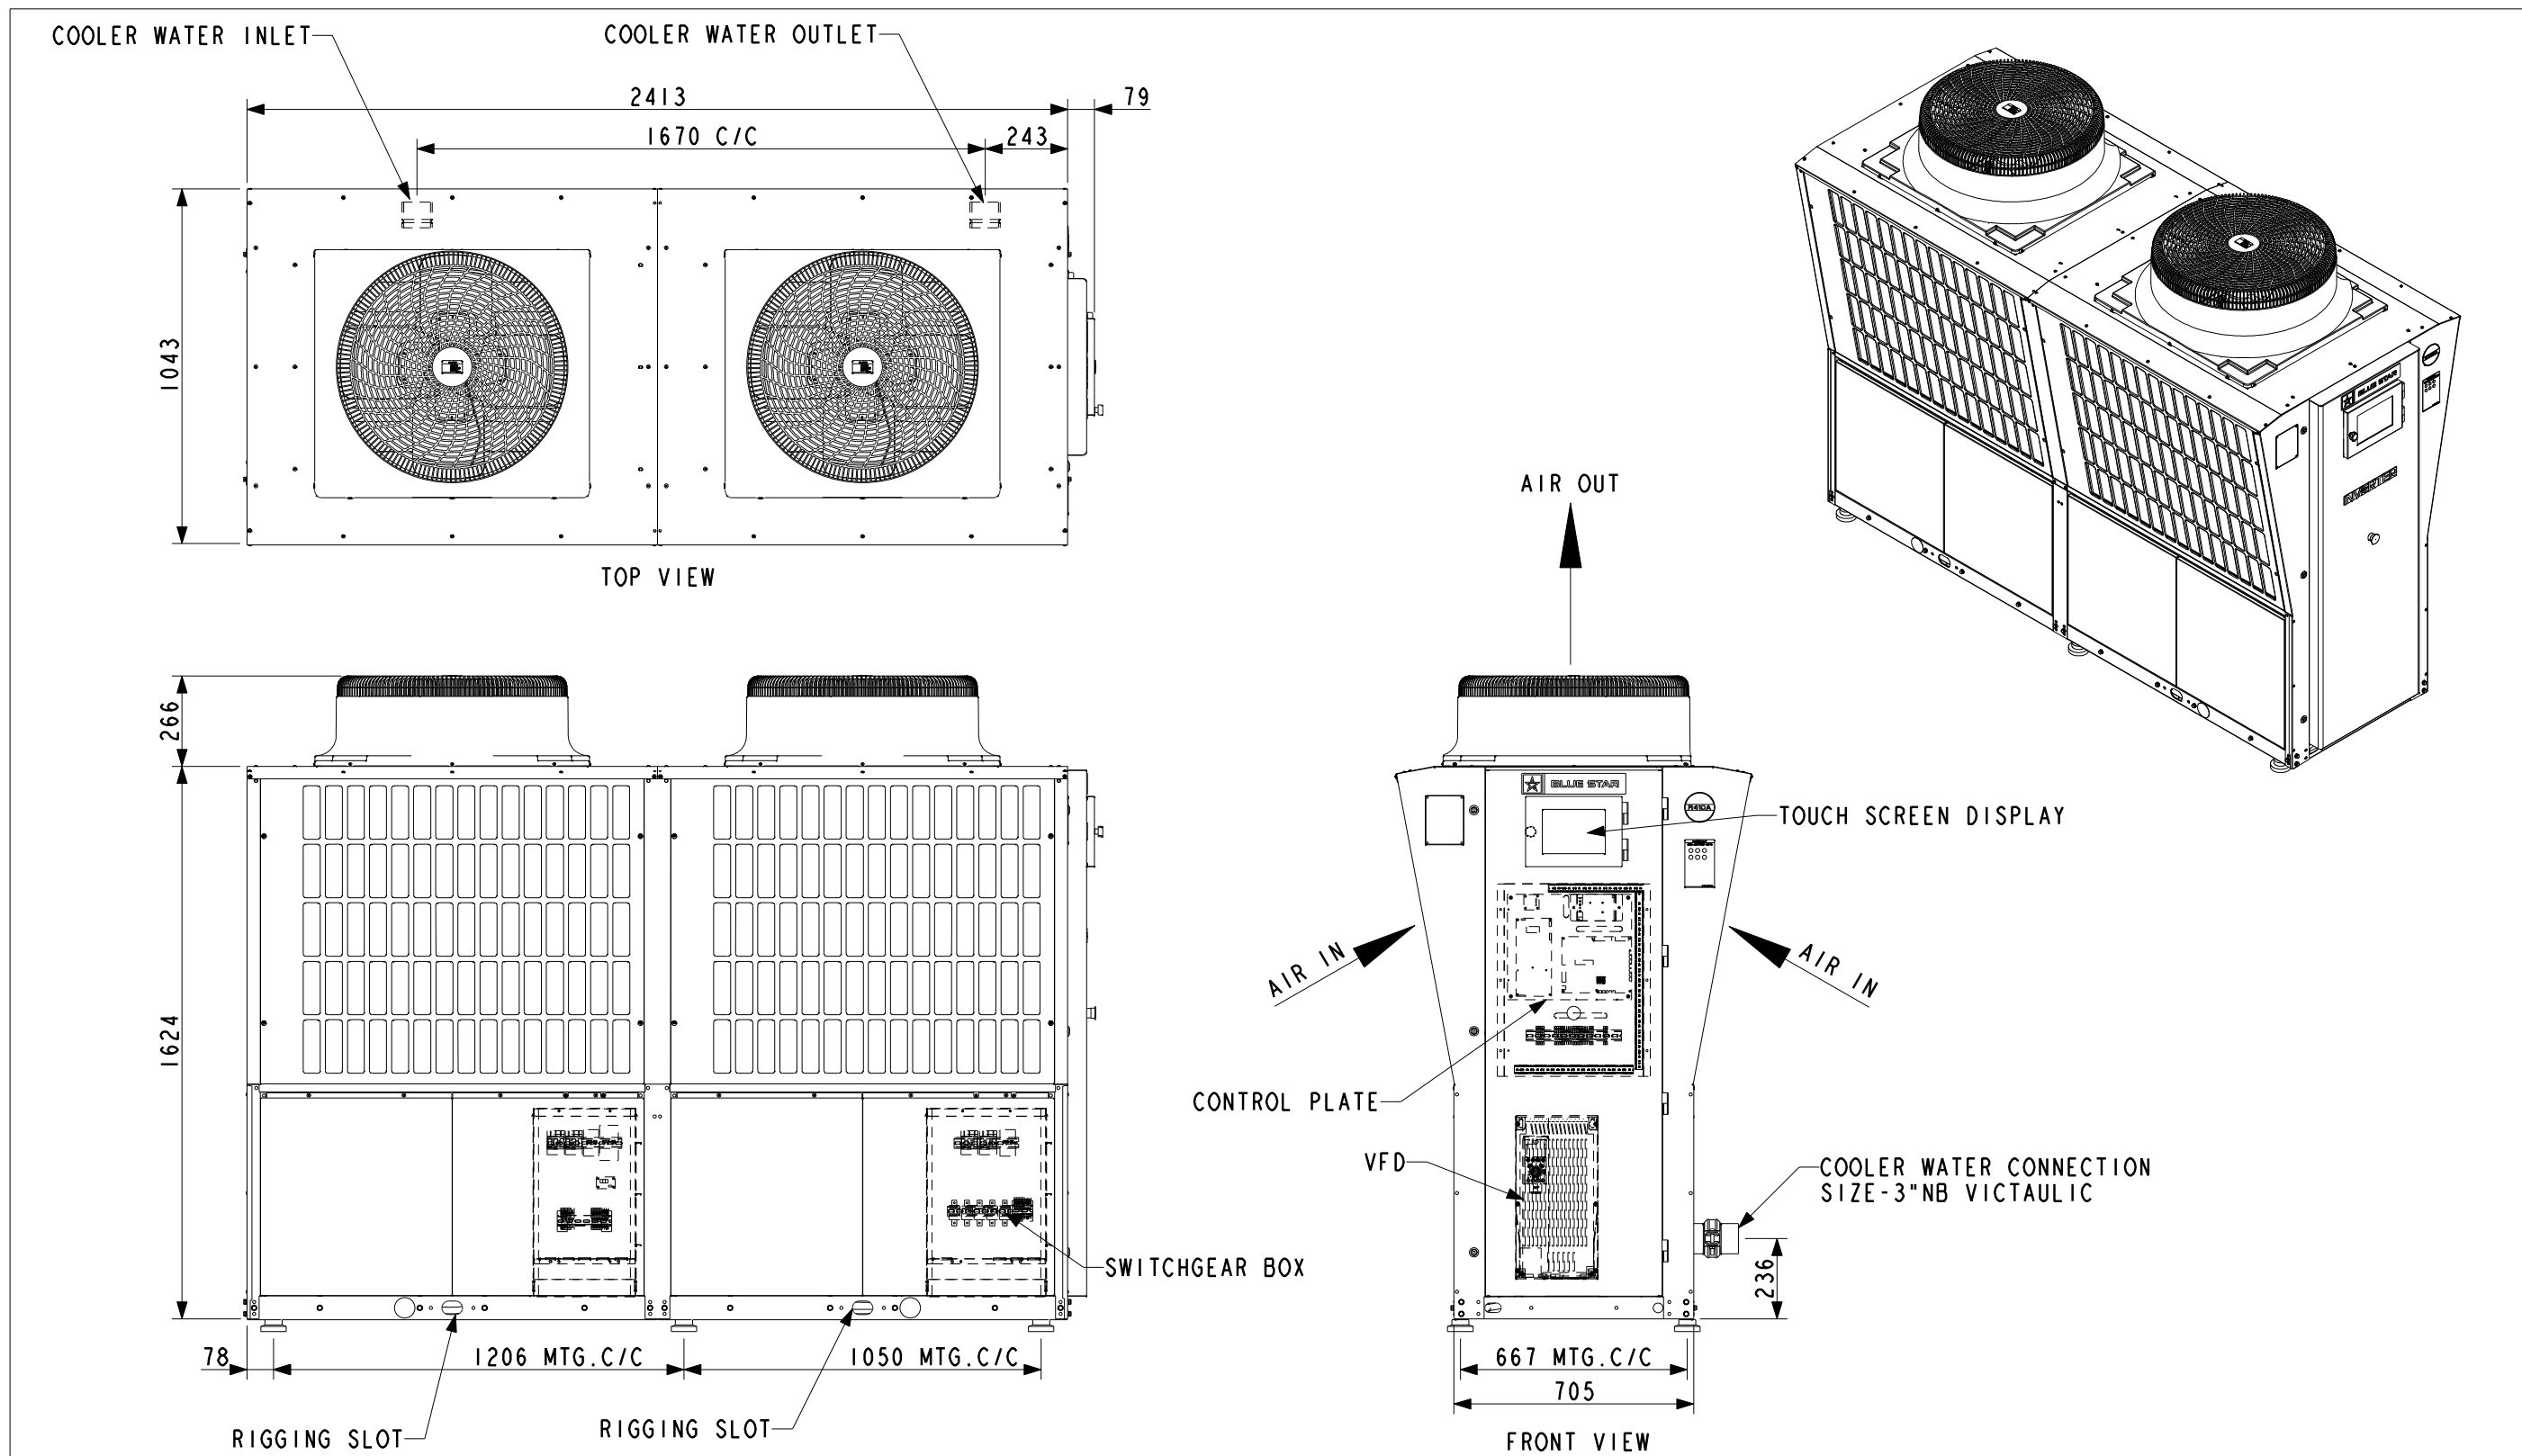

RECOMMENDED CLEARANCES TO PREVENT CONDENSOR AIR RECIRCULATION AND FAULTY OPERATION OF UNIT ARE AS FOLLOWS:

DISTANCE BETWEEN ADJACENT UNITS 12'-0"
NO MORE THAN ONE WALL CAN BE HIGHER THAN TOP OF THE UNIT
UNIT REFR CONNECTION : SWEAT BRAZED TYPE

- 1) SIDE TO WALL 3'-0"
- 2) REAR TO WALL 3'-0"
- 3) TOP 50'-0"
- 4) CONTROL END TO WALL 5'-0"

						SCALE -NTS		CAD ESTIMATED WEIGHT (KG)		-					
								BLUE STAR		GA LAYOUT XAC2VS-024MR3					
						DRN		Dec-11-18		RM		DRAWING No.		SHT 1 OF 1	
CHD		Dec-11-18		SSG		GA-XAC2VS-024MR3				A					
APPD		Dec-11-18		RDG											
REV	DATE	ENGINEERING CHANGE	C.N.No.	DRN	CHD										