
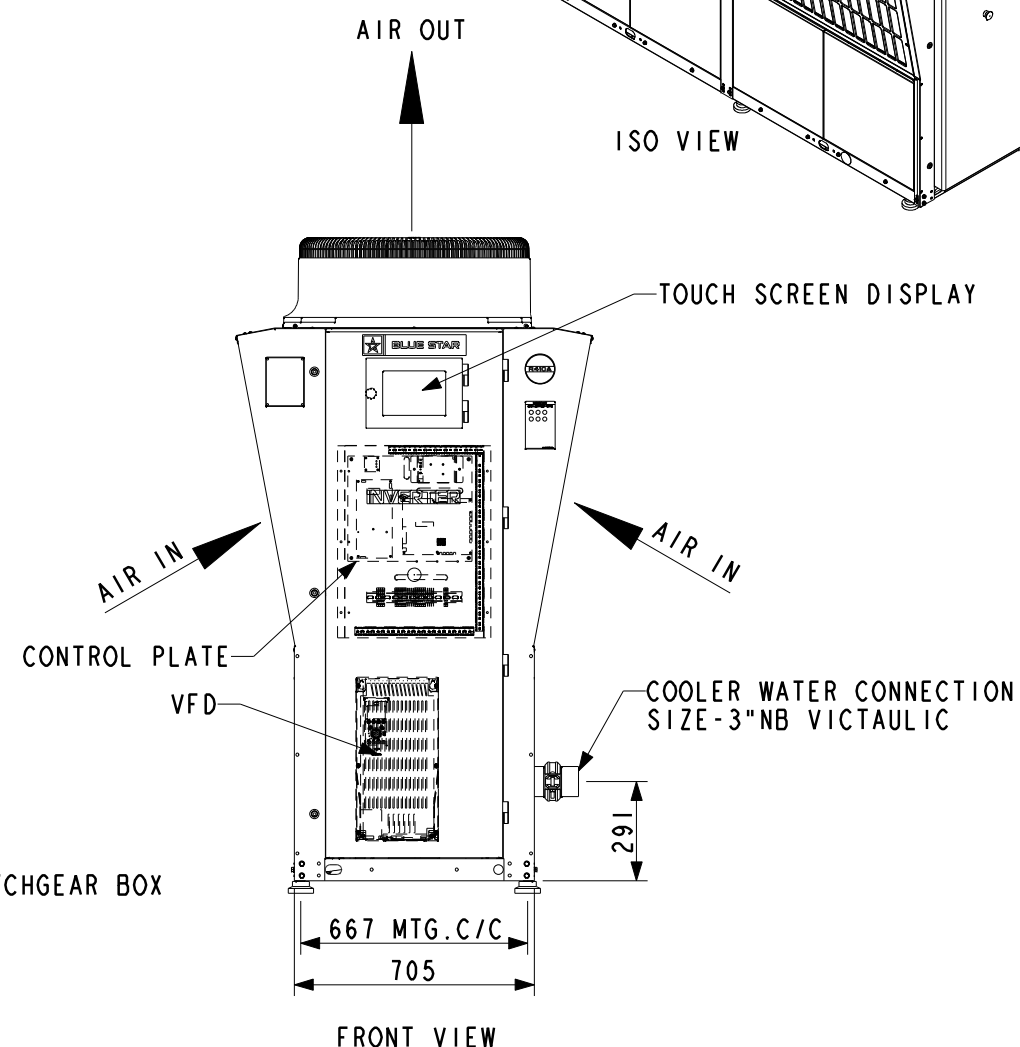
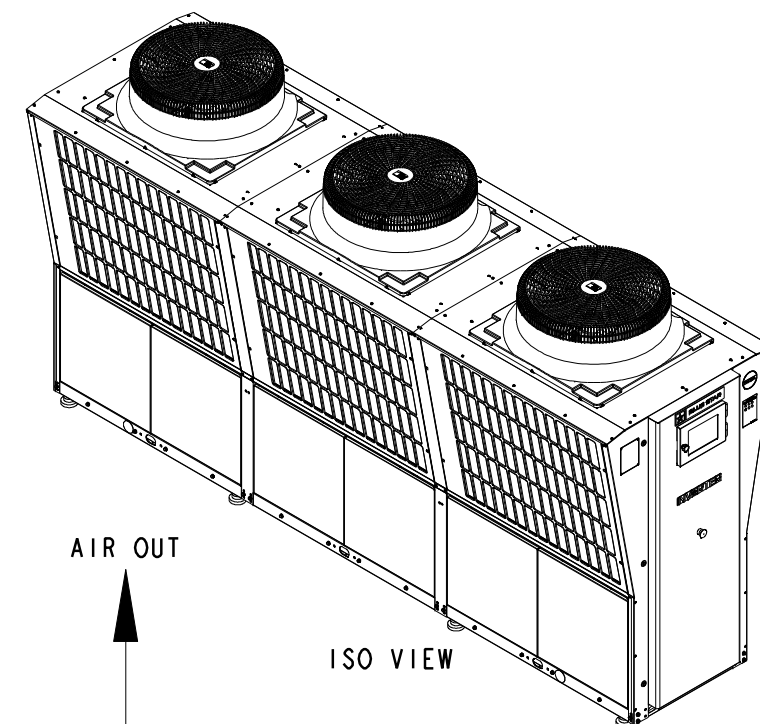
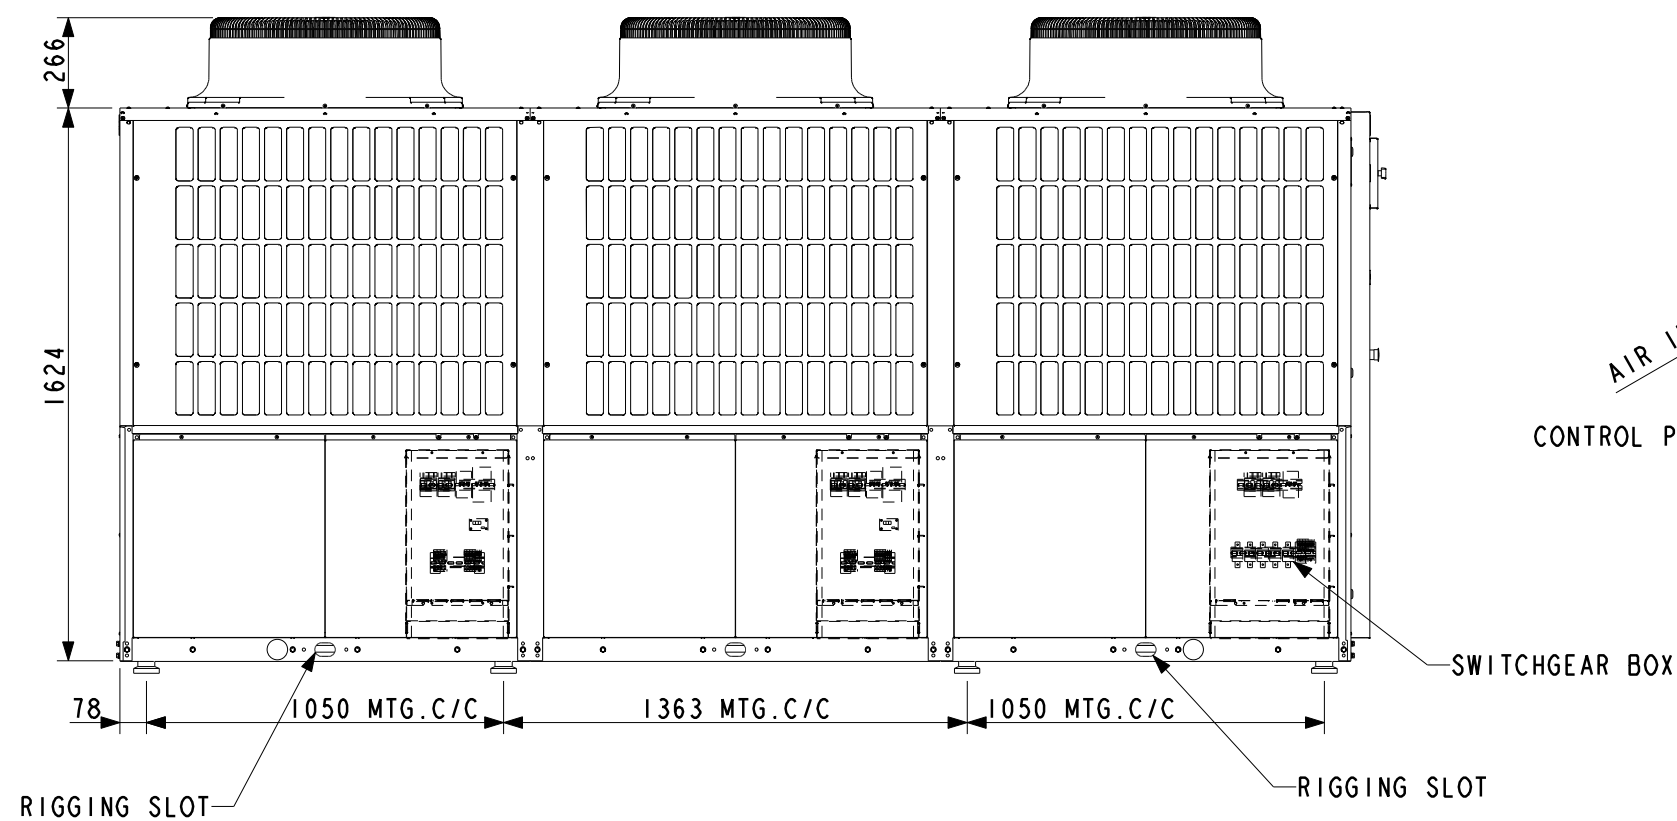


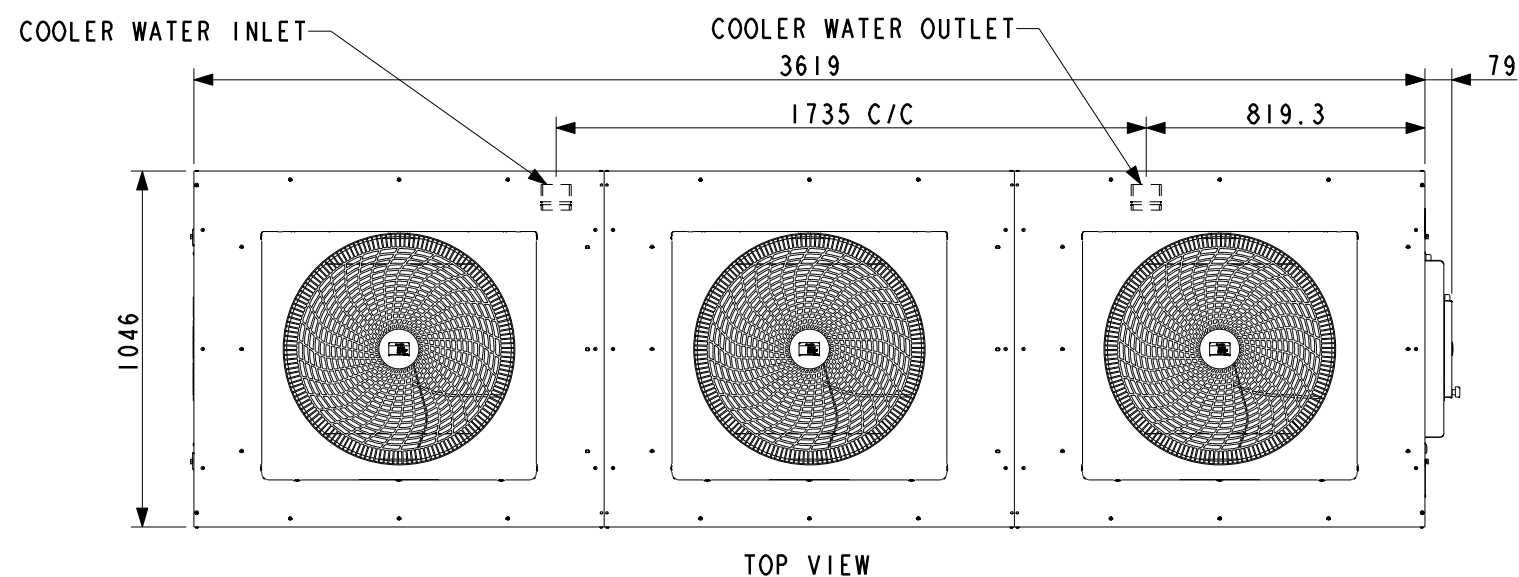

RECOMMENDED CLEARANCES TO PREVENT CONDENSOR AIR RECIRCULATION AND FAULTY OPERATION OF UNIT ARE AS FOLLOWS:

DISTANCE BETWEEN ADJACENT UNITS 12'-0"
NO MORE THAN ONE WALL CAN BE HIGHER THAN TOP OF THE UNIT
UNIT REFR CONNECTION : SWEAT BRAZED TYPE

- 1) SIDE TO WALL 3'-0"
- 2) REAR TO WALL 3'-0"
- 3) TOP 50'-0"
- 4) CONTROL END TO WALL 5'-0"

						SCALE -NTS	CAD ESTIMATED WEIGHT (KG)		-			
							BLUE STAR		GA LAYOUT XAC3VS-036MR3			
						DRN	Dec-11-18	RM	DRAWING No.		SHT 1 OF 1	REV
						CHD	Dec-11-18	SSG				
REV	DATE	ENGINEERING CHANGE	C.N.No.	DRN	CHD	APPD	Dec-11-18	RDG	GA-XAC3VS-036MR3		A	