




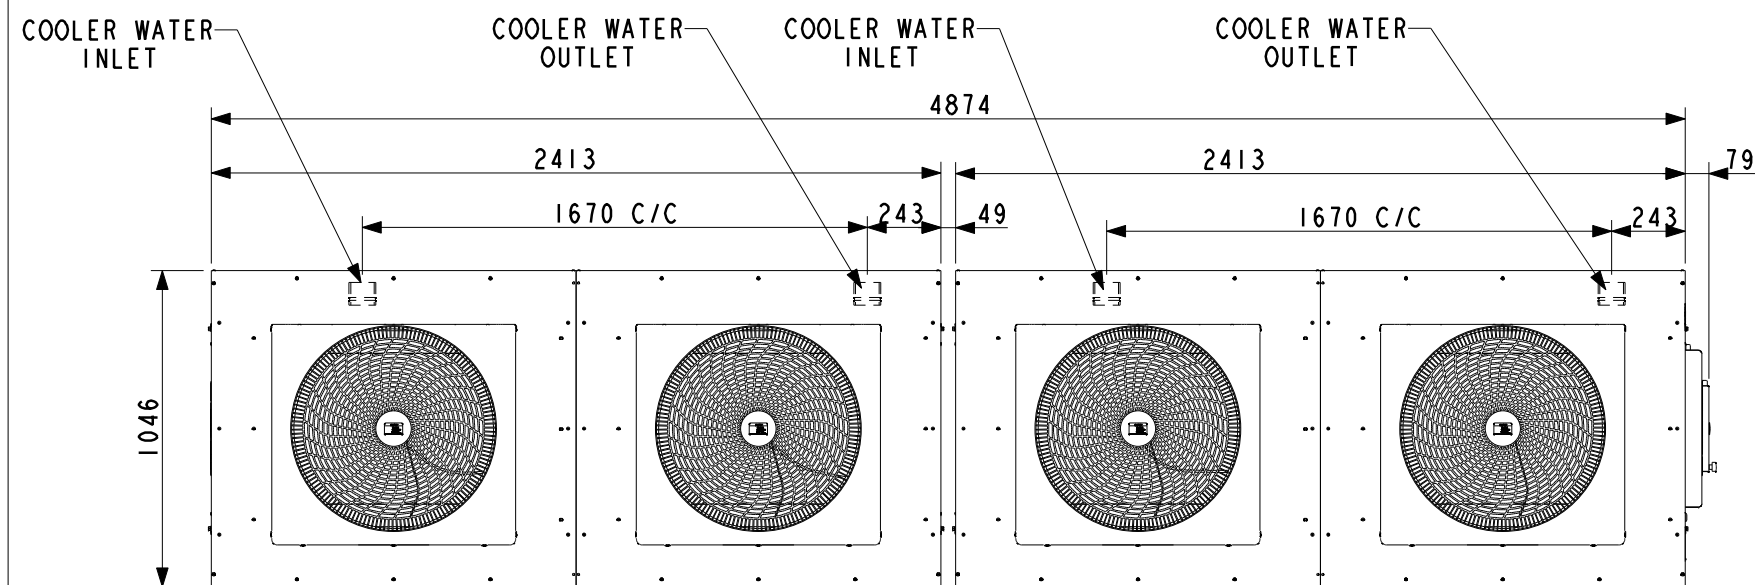

TOP VIEW

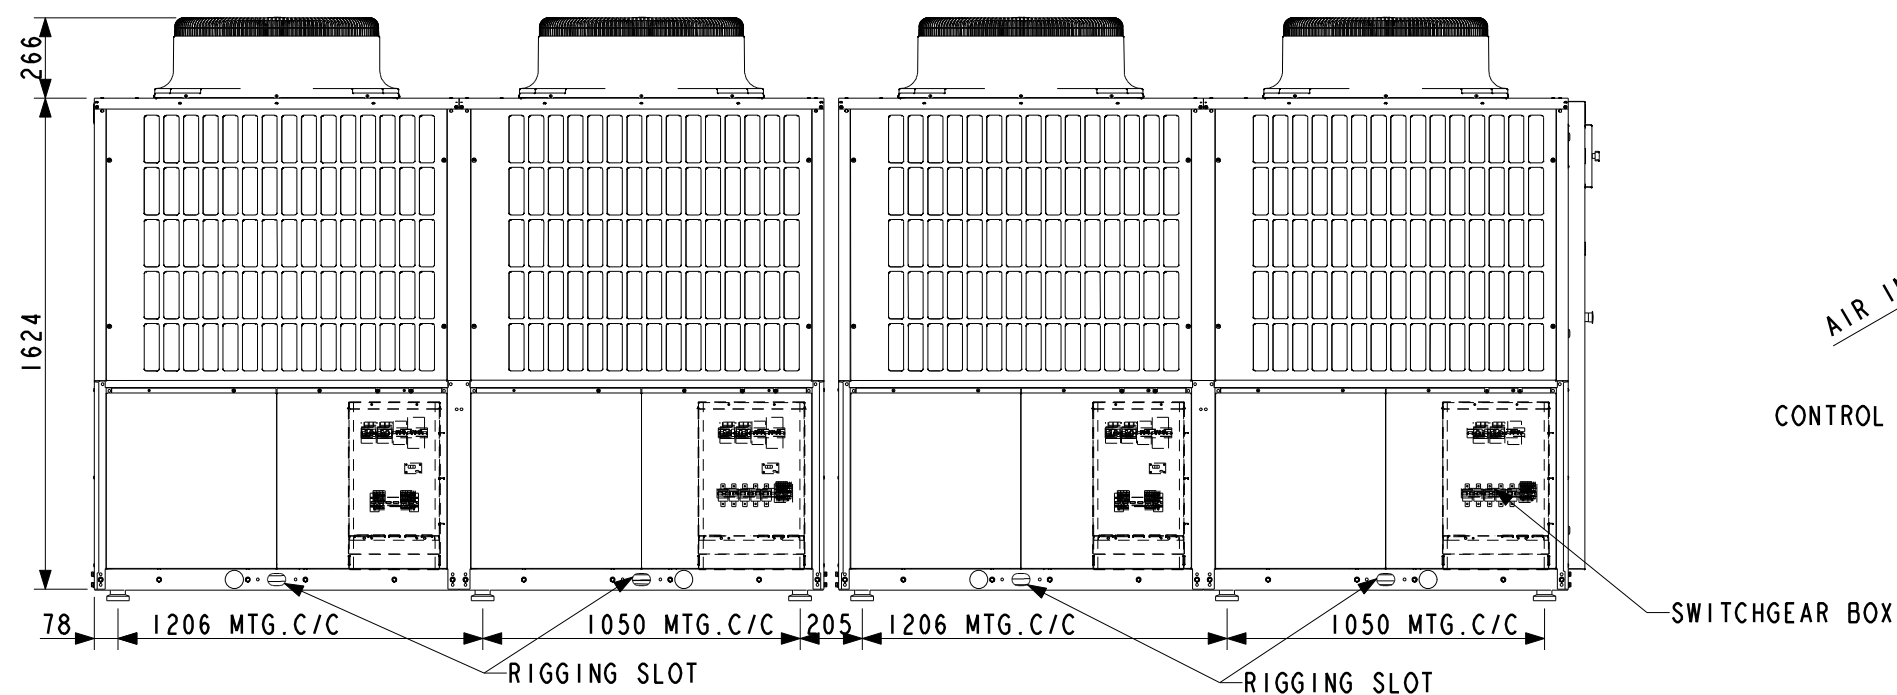

AIR OUT

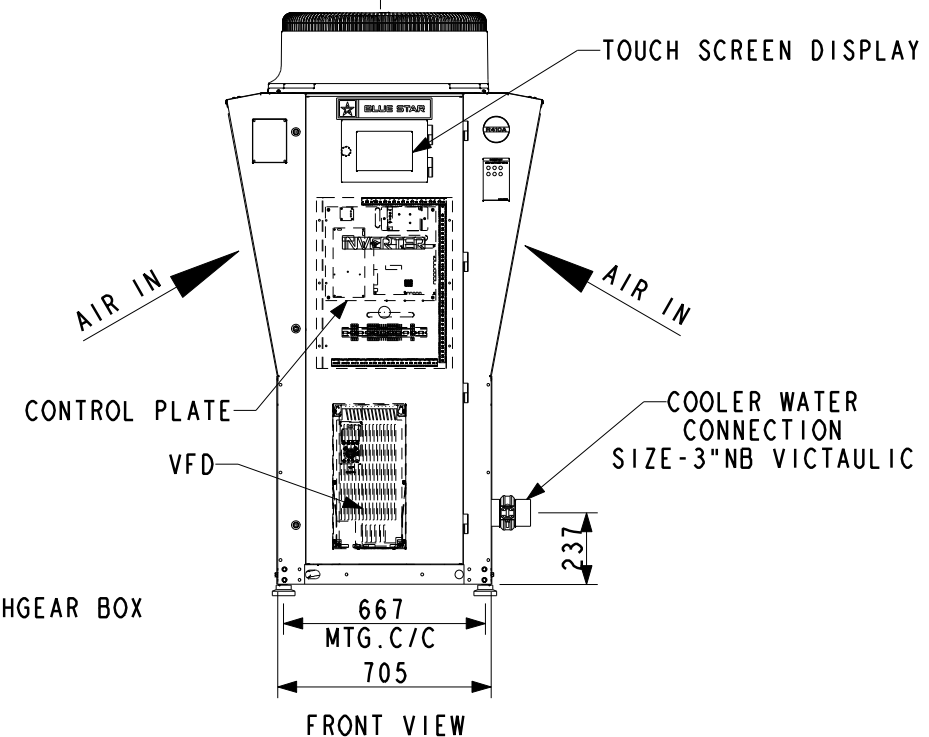

RECOMMENDED CLEARANCES TO PREVENT CONDENSOR AIR RECIRCULATION AND FAULTY OPERATION OF UNIT ARE AS FOLLOWS:

DISTANCE BETWEEN ADJACENT UNITS 12'-0"
NO MORE THAN ONE WALL CAN BE HIGHER THAN TOP OF THE UNIT
UNIT REFR CONNECTION : SWEAT BRAZED TYPE

- 1) SIDE TO WALL 3'-0"
- 2) REAR TO WALL 3'-0"
- 3) TOP 50'-0"
- 4) CONTROL END TO WALL 5'-0"

ALL DIMENSIONS IN MM UNLESS OTHERWISE SPECIFIED | SYMBOLS: ● SAFETY ● MAJOR ○ MINOR △ REVISION □ CRITICAL | THIS DOCUMENT IS THE PROPERTY OF BLUE STAR LTD. AND MUST NOT BE USED WITHOUT PRIOR CONSENT | FORMAT NO:BSA3-17B

						SCALE -NTS		CAD ESTIMATED WEIGHT (KG)		-			
								BLUE STAR		GA LAYOUT XAC4VS-048MR3			
								DATE	NAME	DRAWING No. SHT 1 OF 1 REV A			
						DRN	Dec-11-18	RM					
						CHD	Dec-11-18	SSG	GA-XAC4VS-048MR3				
REV	DATE	ENGINEERING CHANGE	C.N.No.	DRN	CHD	APPD	Dec-11-18	RDG					