


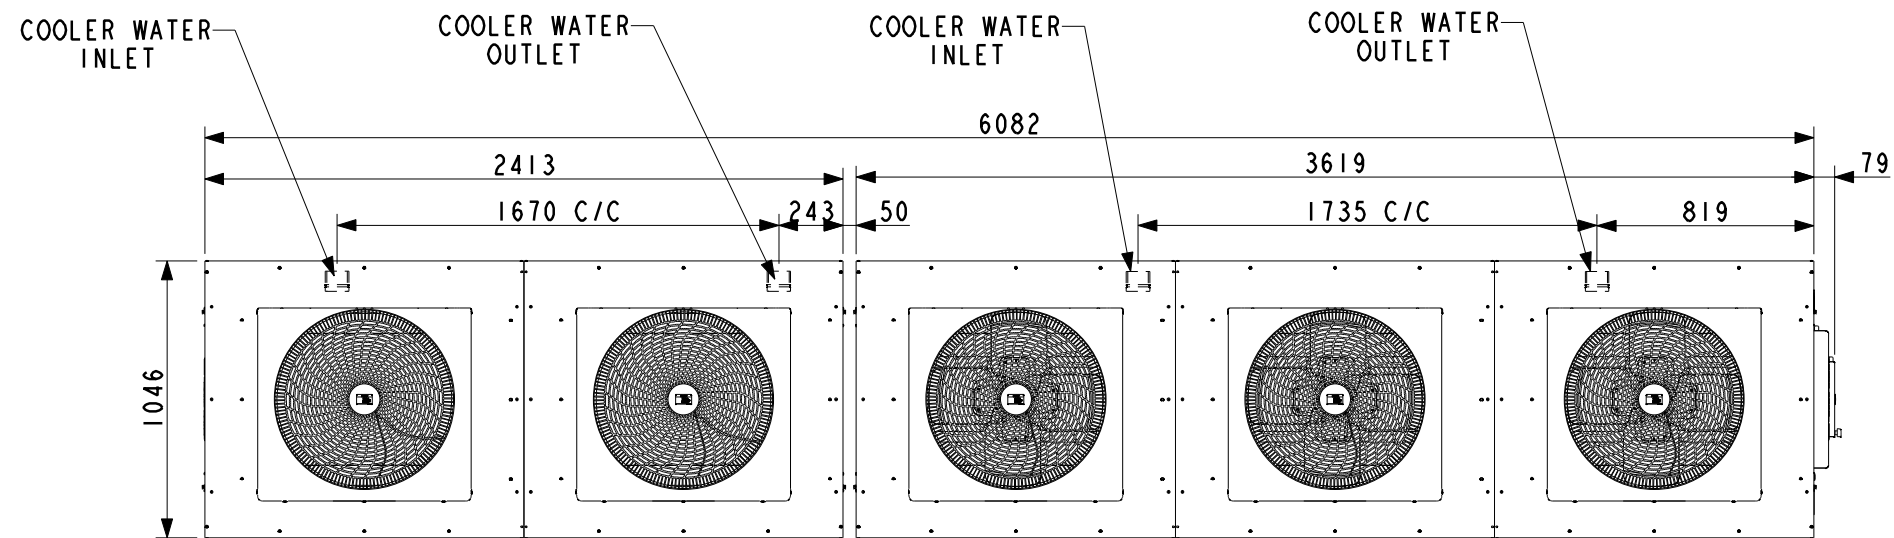


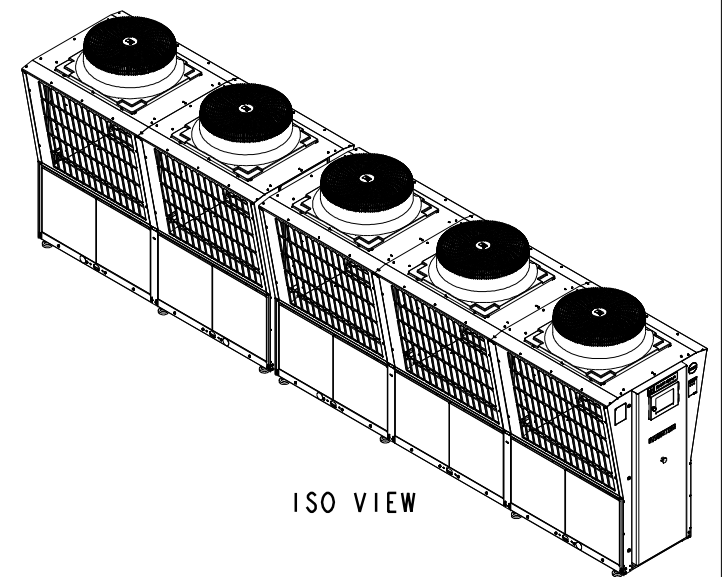

TOP VIEW

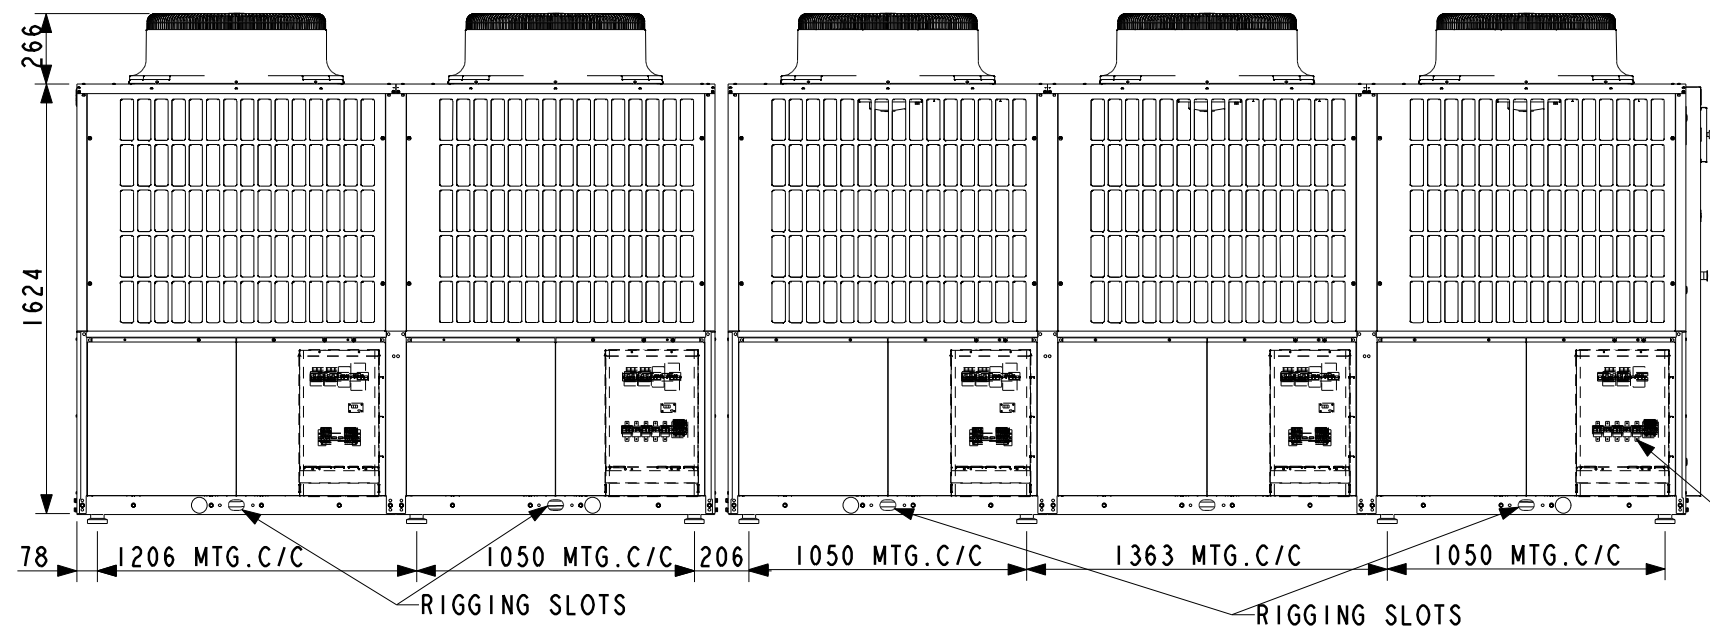

ISO VIEW

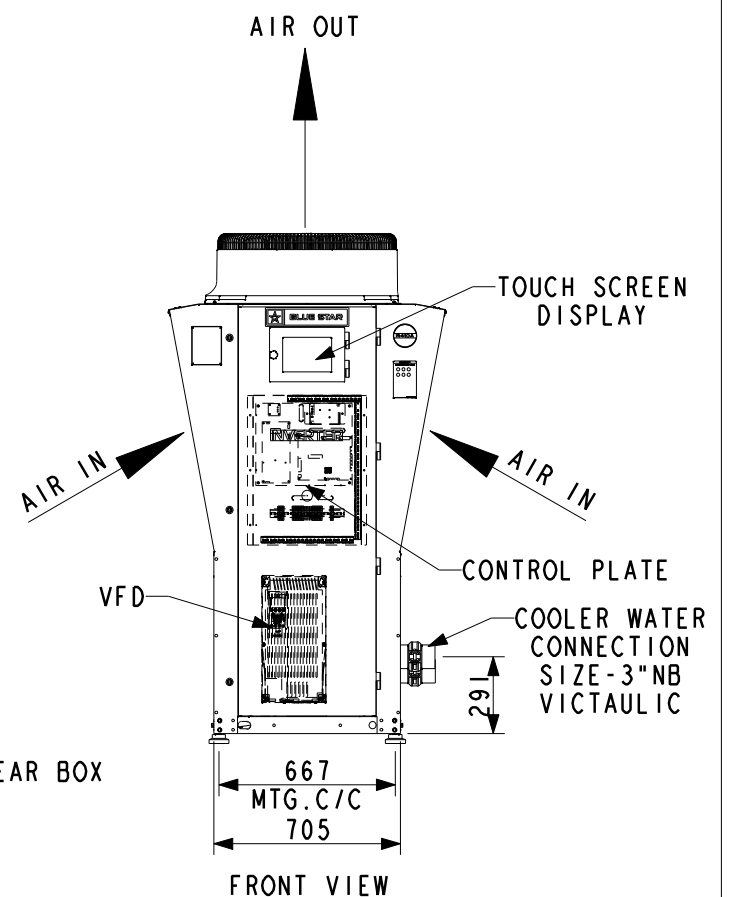

RECOMMENDED CLEARANCES TO PREVENT CONDENSOR AIR RECIRCULATION AND FAULTY OPERATION OF UNIT ARE AS FOLLOWS:

DISTANCE BETWEEN ADJACENT UNITS 12'-0"
NO MORE THAN ONE WALL CAN BE HIGHER THAN TOP OF THE UNIT
UNIT REFR CONNECTION : SWEAT BRAZED TYPE

- 1) SIDE TO WALL 3'-0"
- 2) REAR TO WALL 3'-0"
- 3) TOP 5'-0"
- 4) CONTROL END TO WALL 5'-0"

						SCALE -NTS	CAD ESTIMATED WEIGHT (KG)	-	
							BLUE STAR	GA LAYOUT	
						DATE	NAME	XAC5VS-060MR3	
						DRN	Dec-11-18	RM	DRAWING No. SHT 1 OF 1
						CHD	Dec-11-18	SSG	REV
						APPD	Dec-11-18	RDG	A
REV	DATE	ENGINEERING CHANGE	C.N.No.	DRN	CHD				