


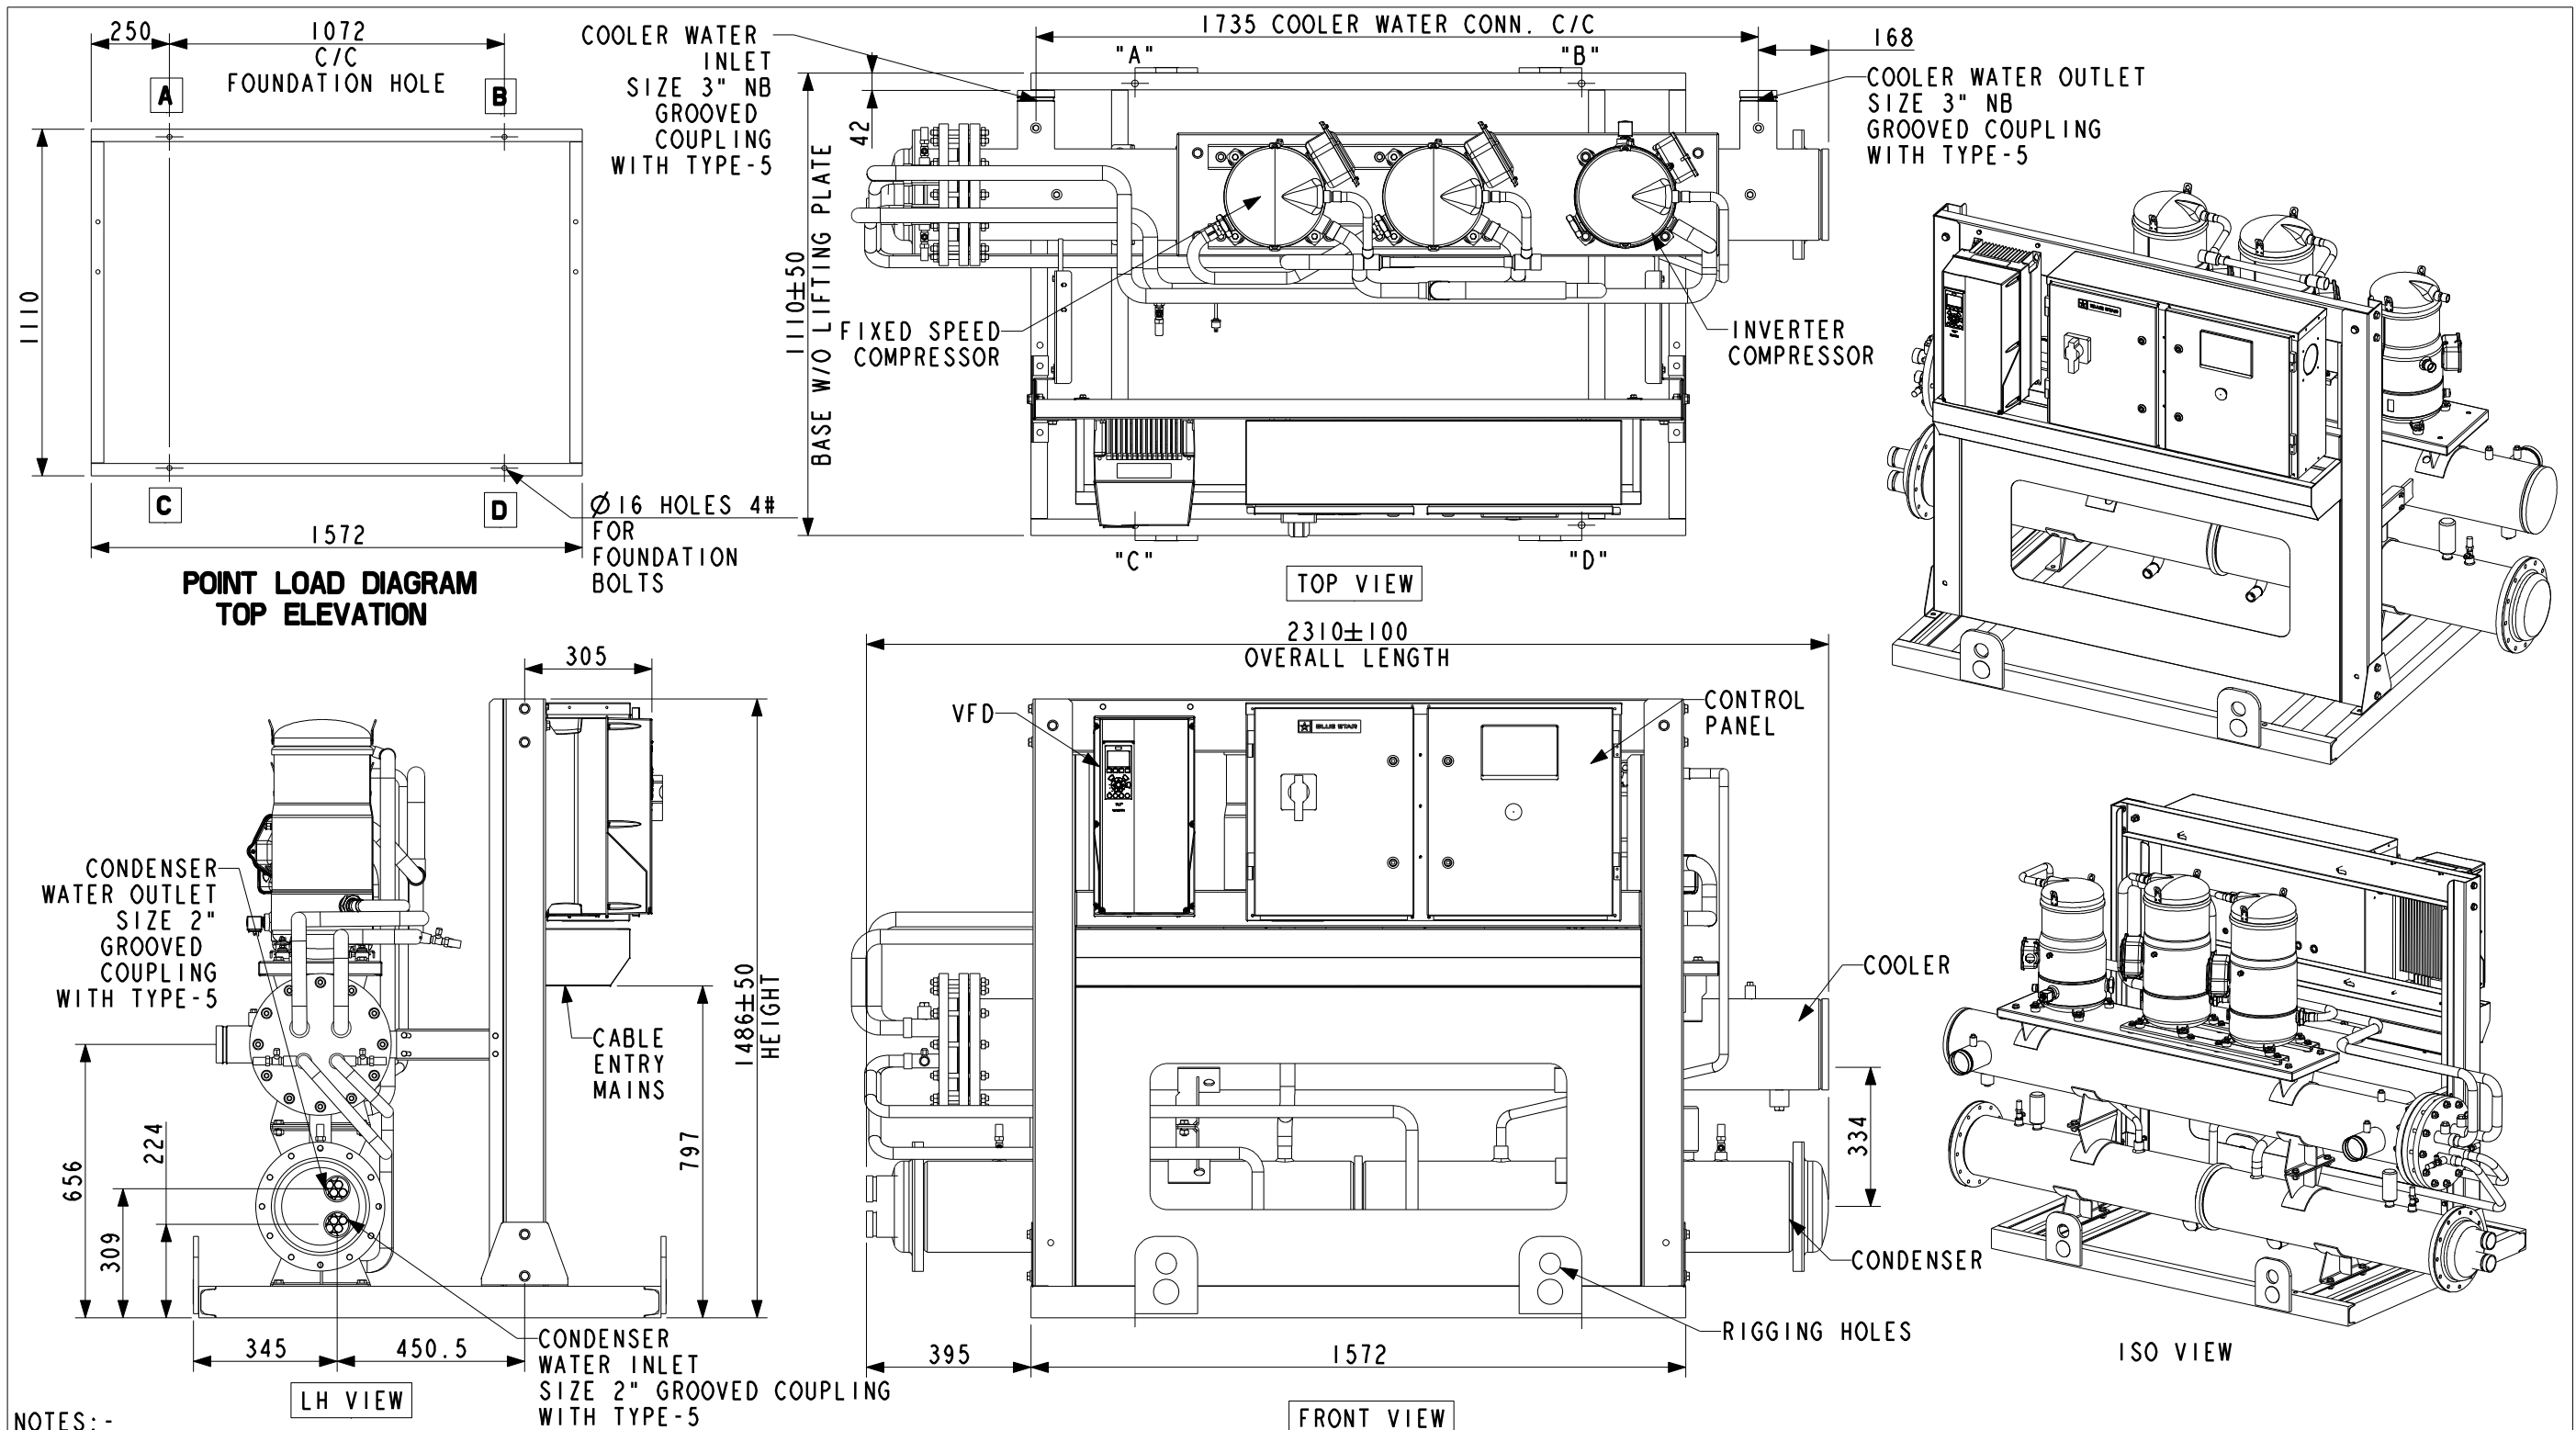

- NOTES:-
- RECOMMENDED MINIMUM CLEARANCES ARE AS FOLLOWS:
 - RH SIDE TO WALL - 2.0 M.
 - LH SIDE TO WALL - 1.0 M. (WITH COOLER CONN.)
 - CONTROL END (FRONT) TO WALL - 1.0 M.
 - TOP-0.6 M.
 - TUBE CLEANING = 2132MM
 - MINIMUM BELT LENGTH (EACH LEG)= 2600MM (8.5 FEET)
 - WATER CONECTIONS FOR CONDENSER & COOLER:VICTAULIC JOINT (FOR SIZES REFER TABLE)(SUITABLE TO NATIONAL RIGID COUPLING STYLE 5
 - BACKSIDE TO WALL (COOLER WATER CONN)= 1.0 M
 - POINT LOAD EQUALLY DISTRIBUTED ON A, B, C & D.
 - ALL DIMENSIONS ARE SUBJECT TO CHANGE DUE TO CONTINUOUS IMPROVEMENT.

						SCALE -NTS		--		--							
								BLUE STAR		GENERAL ARRANGEMENT WATER COOLED INVERETER SCROLL CHILLER							
						DATE		NAME		DRAWING No.		SHT 1 OF 1		REV			
						DRN		Aug-27-19								LM	
						CHD		Aug-27-19		NBC		GA-XWC2YVS-039AR3		--			
REV		DATE		ENGINEERING CHANGE		C.N.No.		DRN		CHD						APPD	