


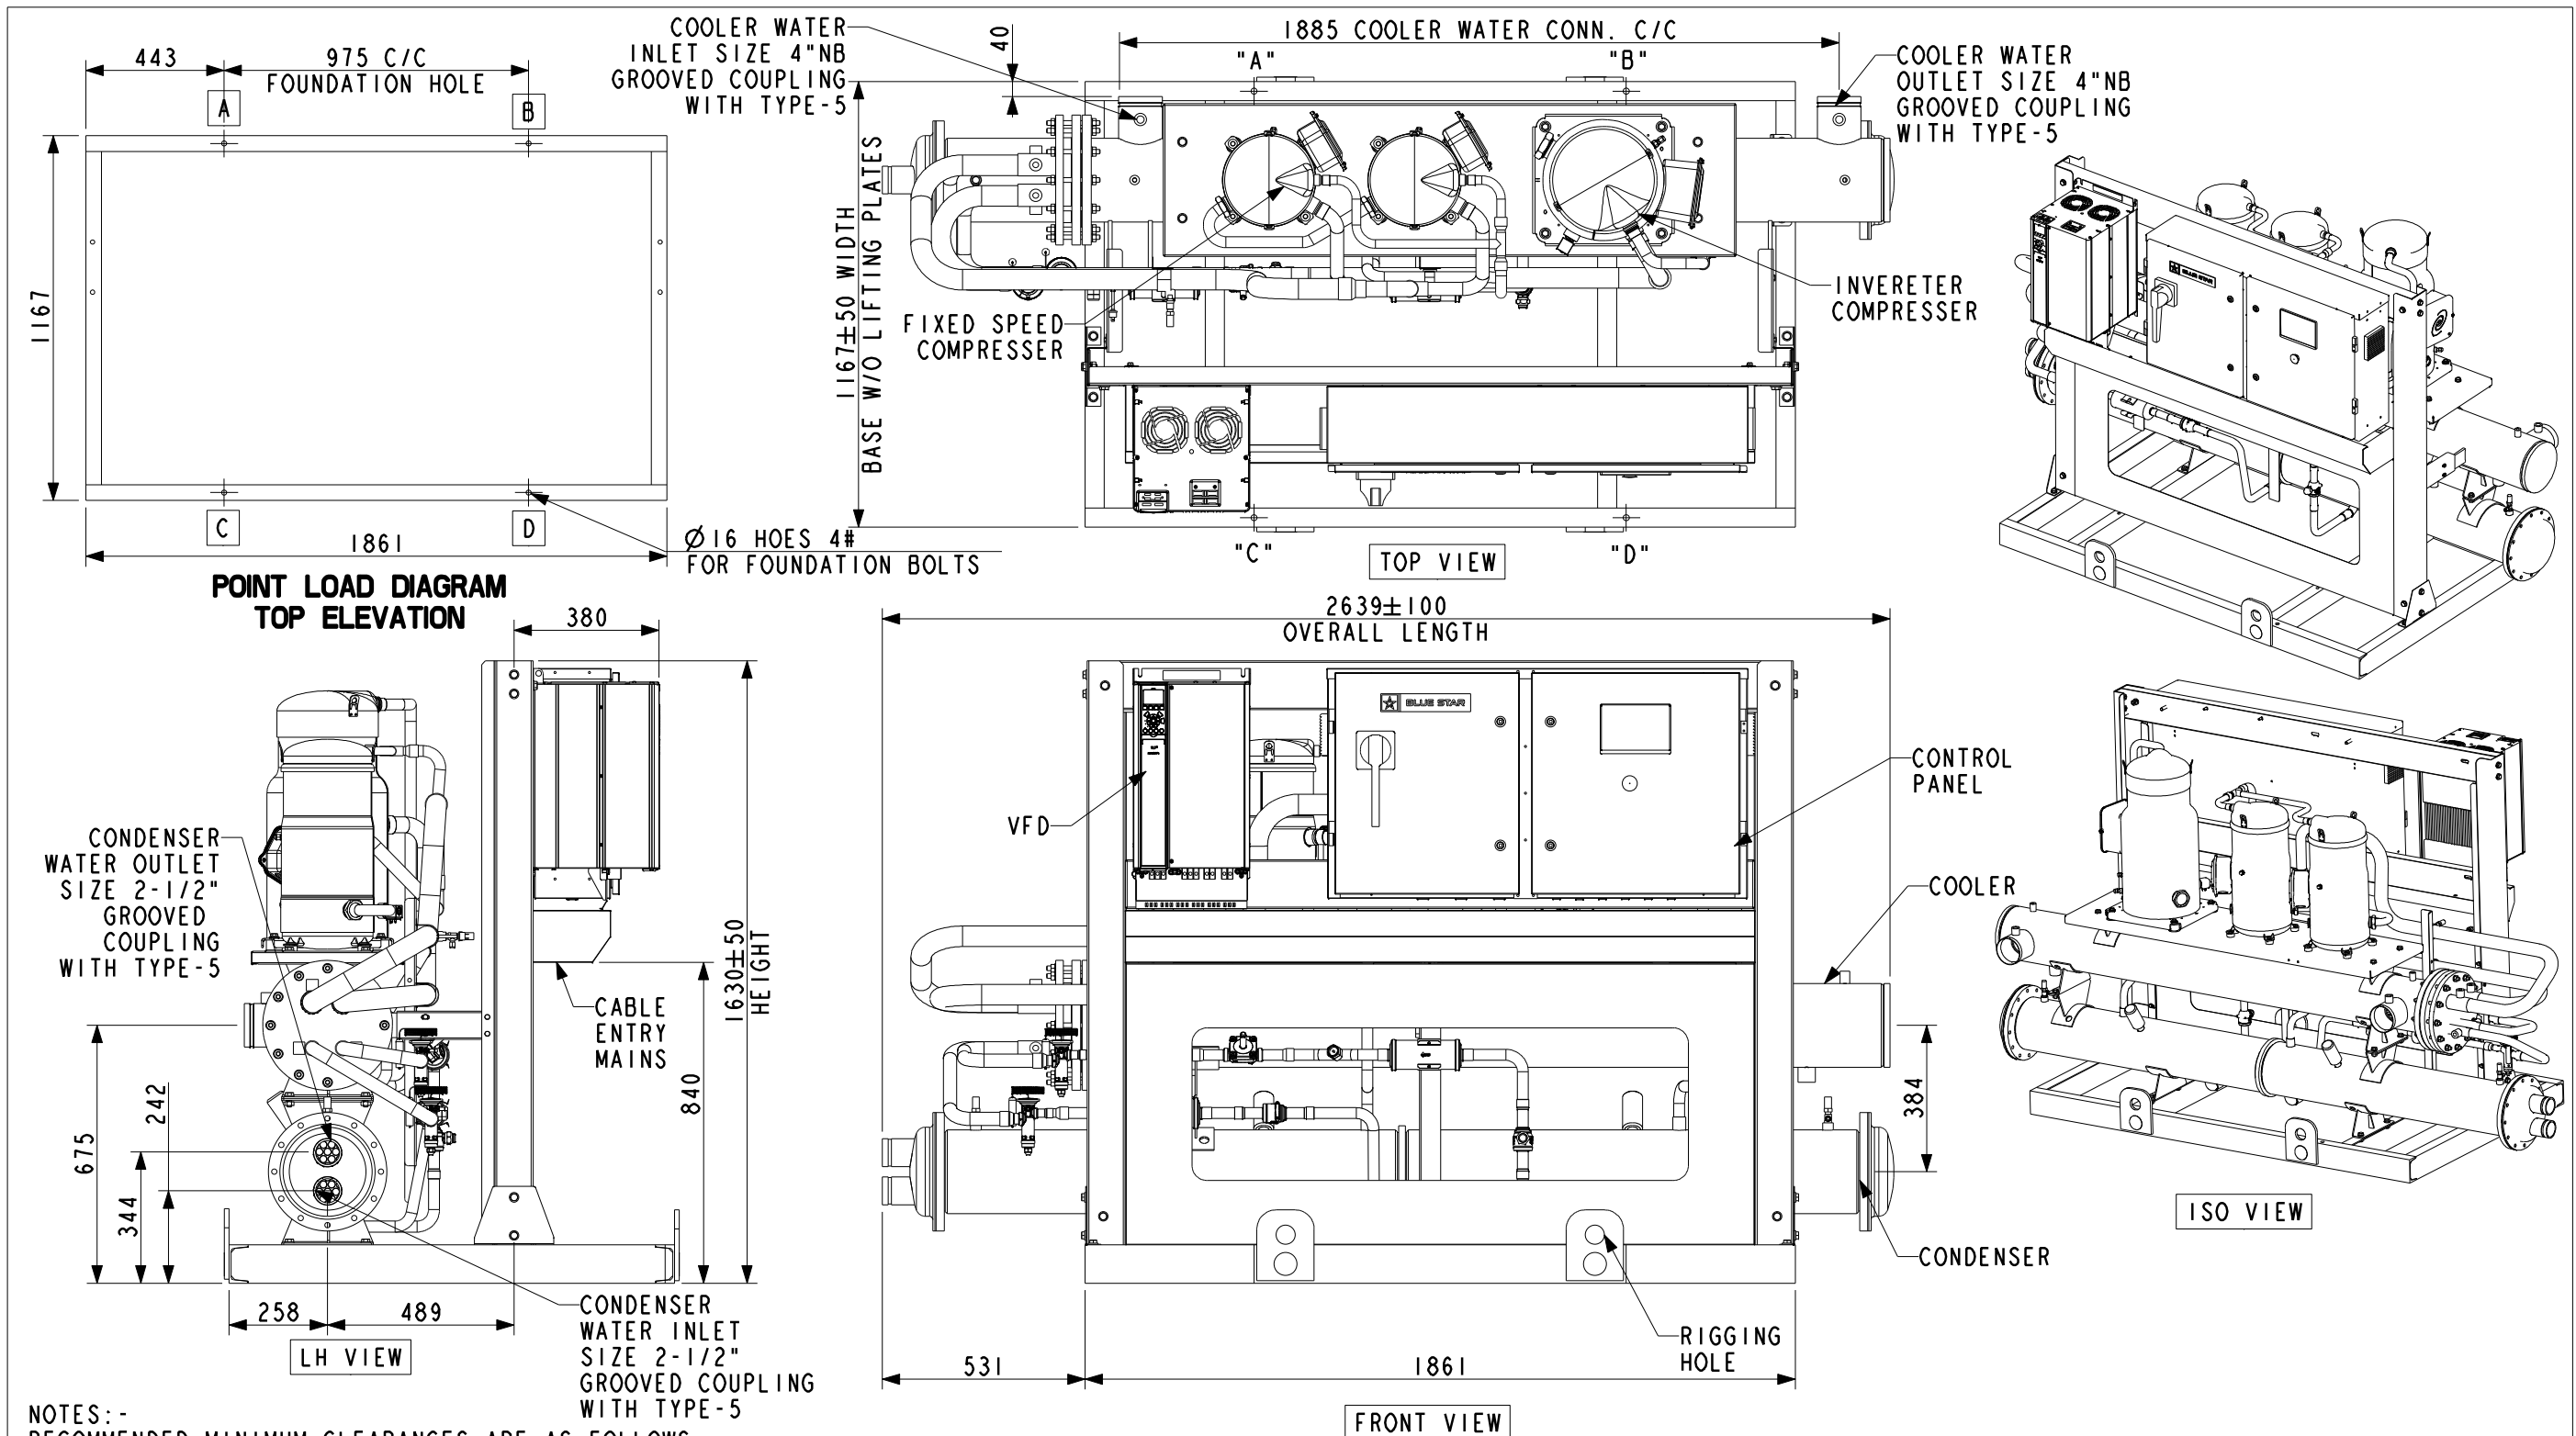

NOTES:-
 RECOMMENDED MINIMUM CLEARANCES ARE AS FOLLOWS:
 • RH SIDE TO WALL - 2.0 M.
 • LH SIDE TO WALL - 1.0 M. (WITH COOLER CONN.)
 • CONTROL END (FRONT) TO WALL - 1.0 M.
 • TOP-0.6 M.
 • TUBE CLEANING = 2442MM
 • MINIMUM BELT LENGTH (EACH LEG)= 2600MM (8.5 FEET)
 • WATER CONECTIONS FOR CONDENSER & COOLER:VICTAULIC JOINT (FOR SIZES REFER TABLE)(SUITABLE TO NATIONAL RIGID COUPLING STYLE 5
 • BACKSIDE TO WALL (COOLER WATER CONN.)= 1.0 M
 • POINT LOAD EQUALLY DISTRIBUTED ON A, B, C & D.
 • ALL DIMENSIONS ARE SUBJECT TO CHANGE DUE TO CONTINUOUS IMPROVEMENT.

						SCALE -NTS		--	--			
							BLUE STAR		GENERAL ARRANGEMENT			
								WATER COOLED INVERTER SCROLL CHILLER				
						DRN	Oct-07-19	LM	DRAWING No. SHT 1 OF 1 REV			
						CHD	Oct-07-19	NBC				
						APPD	Oct-07-19	RDG				
REV	DATE	ENGINEERING CHANGE		C.N.No.	DRN	CHD	GA-XWC2YVS-052AR3					