


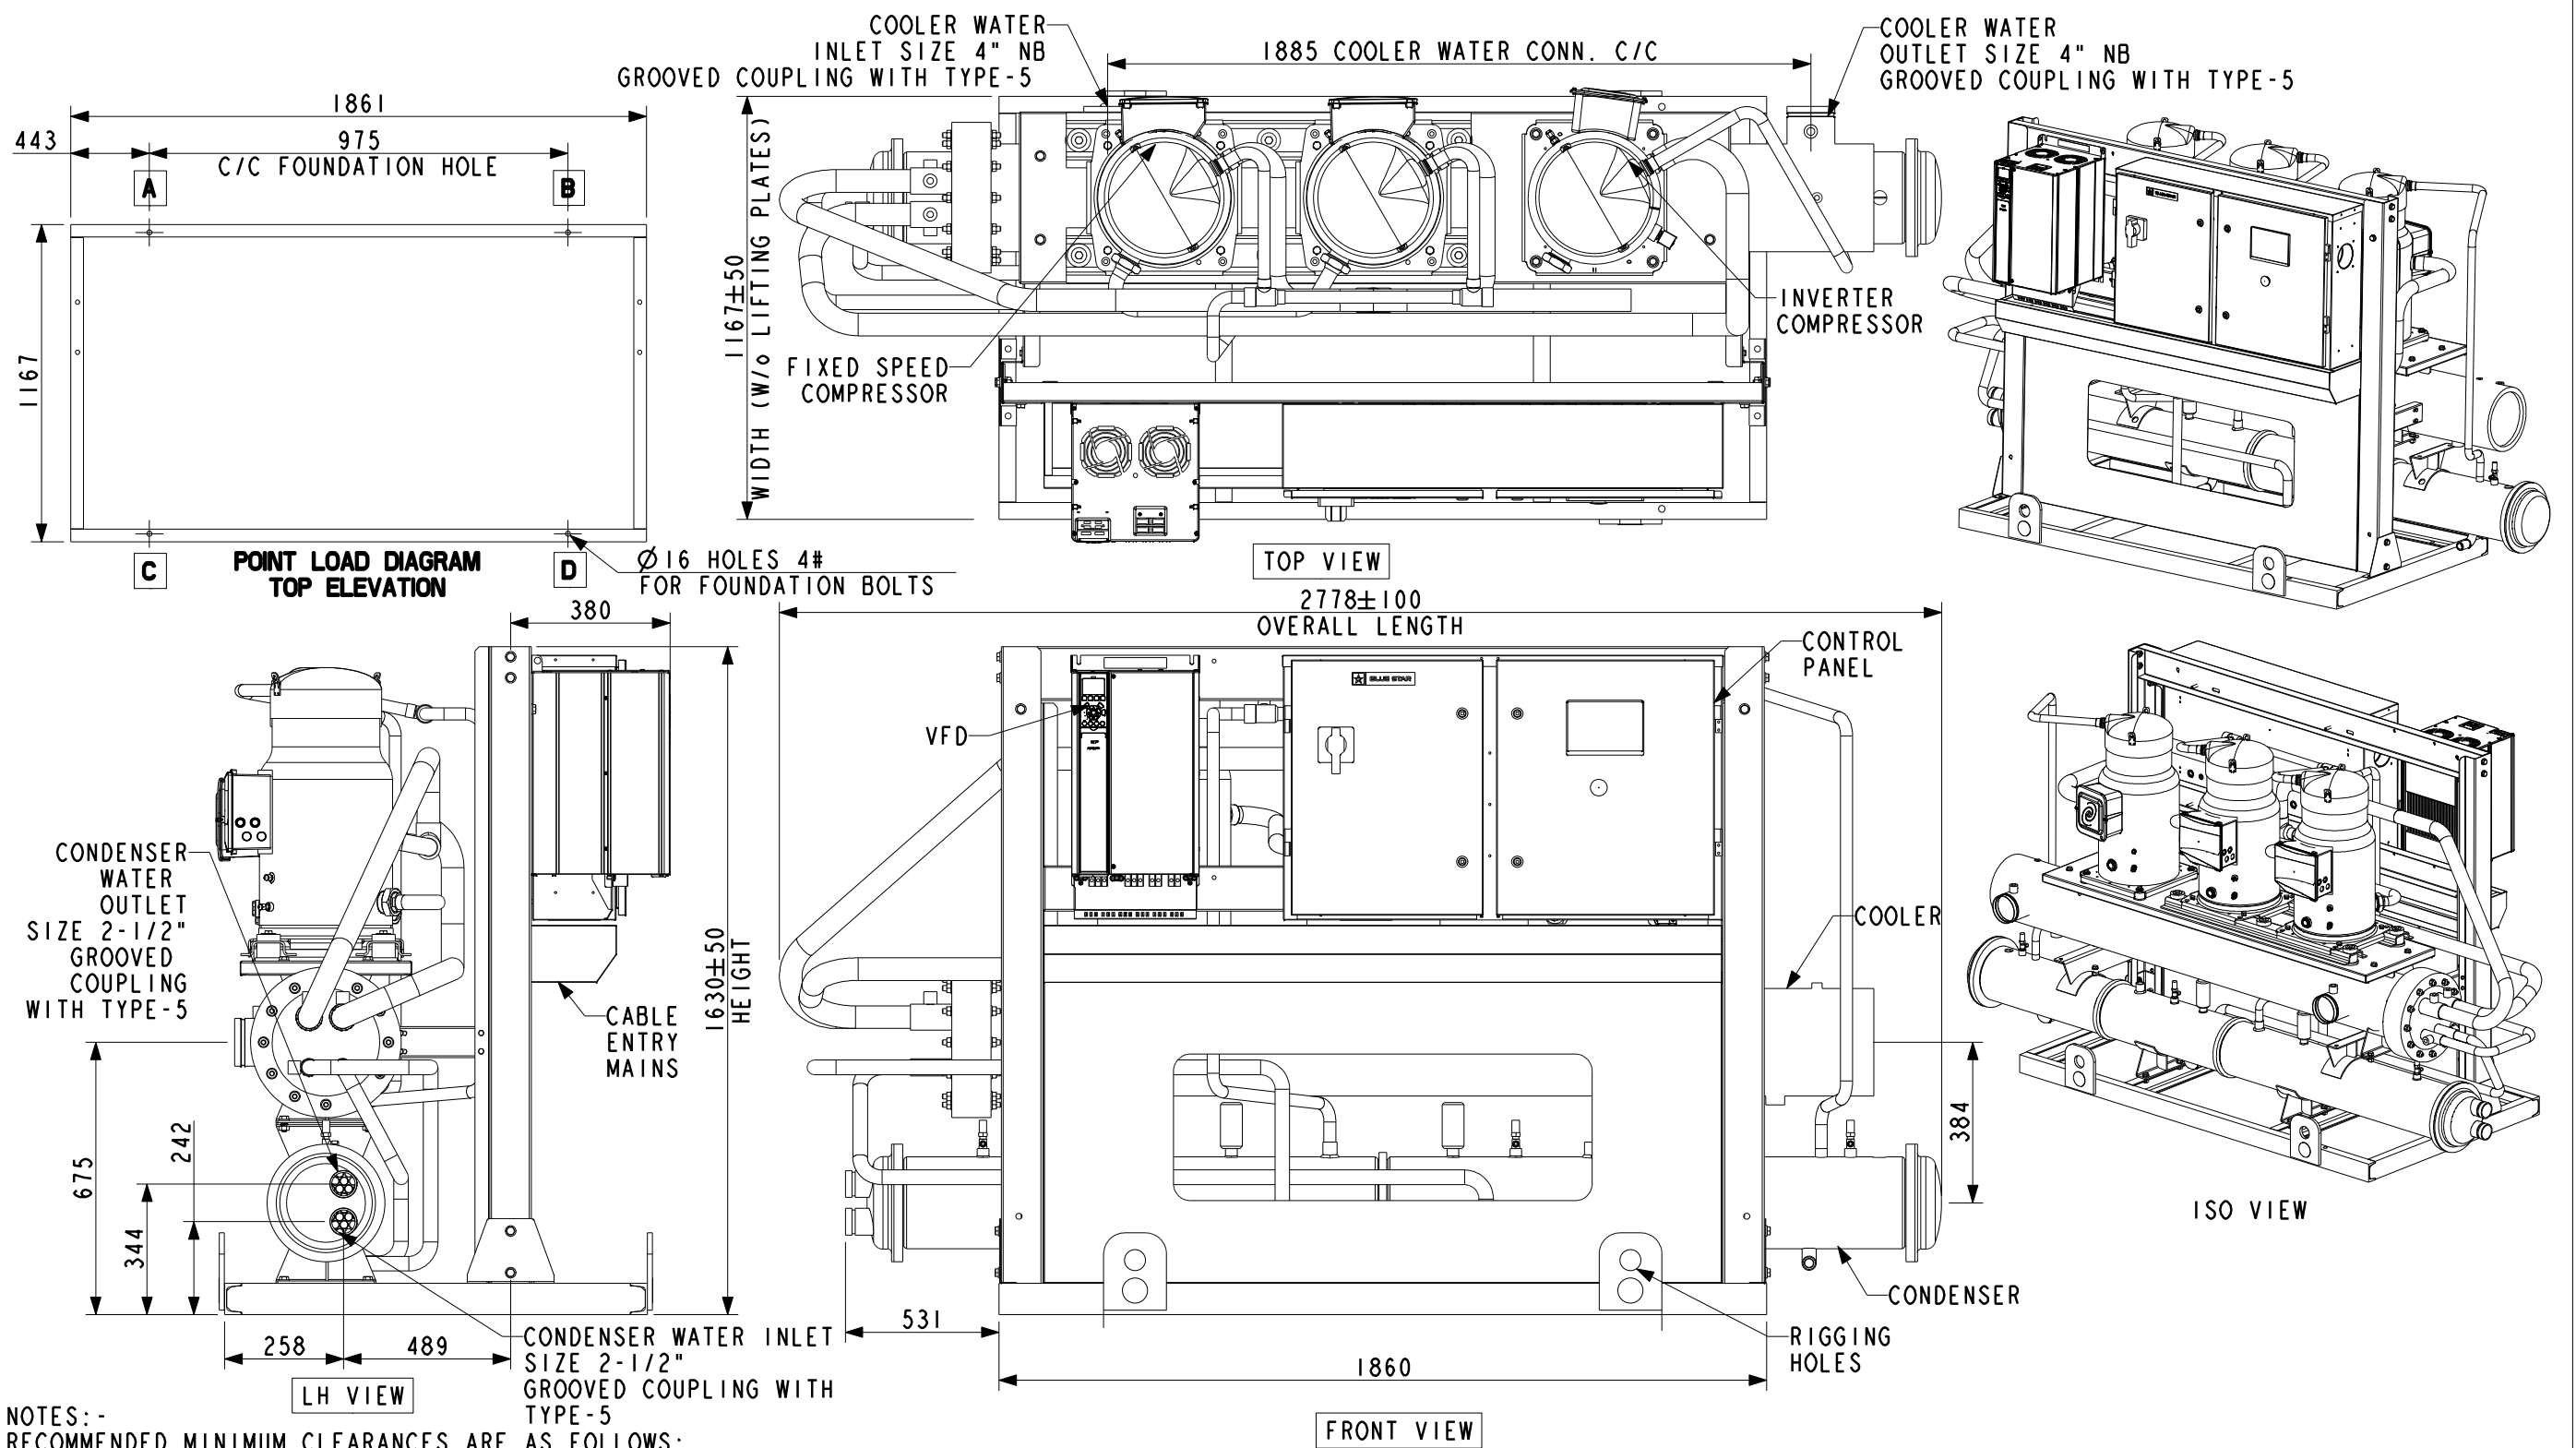

- NOTES:-
RECOMMENDED MINIMUM CLEARANCES ARE AS FOLLOWS:
- RH SIDE TO WALL - 2.0 M.
 - LH SIDE TO WALL - 1.0 M. (WITH COOLER CONN.)
 - CONTROL END (FRONT) TO WALL - 1.0 M.
 - TOP-0.6 M.
 - TUBE CLEANING = 2442MM
 - MINIMUM BELT LENGTH (EACH LEG)= 2600MM (8.5 FEET)
 - WATER CONECTIONS FOR CONDENSER & COOLER:VICTAULIC JOINT (FOR SIZES REFER TABLE)(SUITABLE TO NATIONAL RIGID COUPLING STYLE 5
 - BACKSIDE TO WALL (COOLER WATER CONN)= 1.0 M
 - POINT LOAD EQUALLY DISTRIBUTED ON A, B, C & D.
 - ALL DIMENSIONS ARE SUBJECT TO CHANGE DUE TO CONTINUOUS IMPROVEMENT.

						SCALE -NTS		--	--	
							BLUE STAR		GENERAL ARRANGEMENT	
									WATER COOLED INV SCROLL CHILLER	
						DRN	Aug-28-19	LM	DRAWING No. SHT 1 OF 1 REV	
						CHD	Aug-28-19	NBC	GA-XWC2YVS-065AR3	
REV	DATE	ENGINEERING CHANGE	C.N.No.	DRN	CHD	APPD	Aug-28-19	RDG	-	